

GOVERNMENT OF WEST BENGAL
OFFICE OF THE DIRECTOR GENERAL
WEST BENGAL FIRE & EMERGENCY SERVICES
13-D, Mirza Galib Street, Kolkata - 700 016.

Memo. No. : WBFES/ 4725/14 /Kol-RB/05/14 (05/14) Date : ...15.10/14

From : The Director in Charge (Fire Prevention Wing)
West Bengal Fire & Emergency Services.

To : Mr. Rajendra Kumar Sarongi,
Arch Infra Properties Pvt. Ltd.,
Tegharia Rajarhat,
Kolkata.


Sub : Fire Safety Recommendation for Proposed construction of B+G+X storied (Tower-1 to 7) & B+G+VII Storied (Tower-8) Under Group Residential Building at premises No.- Dag No-534 of Mouza-Tegharia, J.L. No-9 & 10, Dag No-139, 140, 143 & 144 of Mouza-Atgharia, L.R. Khatian No-1654, 1643, 1662, 1639, 1640, 707, 707, 1642, 1645, 1637, 1663, 1666, 1656, 1663, 1650, 1657, 1637, 1646827/653/1850, 2072, 1657, 1664, 1651, 1654, 1666, 1649, 470, 1653, 1675, 1662, 707, 1651, 781/1, 782/2, 1658, 55, 1689/1765, 1639, 1643, 1649, 1640, 1658, P.S.-Baguiati, Dist.-24Pgs(N), under Rajarhat Gopalpur Municipality.

This is in reference to your letter No. Nil dated 14.03.2013 regarding Fire Safety Recommendation for proposed Construction of B+G+X storied (Tower-1 to 7) & B+G+VII Storied (Tower-8) Under Group Residential Building at premises No.- Dag No-534 of Mouza-Tegharia, J.L. No-9 & 10, Dag No-139, 140, 143 & 144 of Mouza-Atgharia, L.R. Khatian No-1654, 1643, 1662, 1639, 1640, 707, 707, 1642, 1645, 1637, 1663, 1666, 1656, 1663, 1650, 1657, 1637, 1646827/653/1850, 2072, 1657, 1664, 1651, 1654, 1666, 1649, 470, 1653, 1675, 1662, 707, 1651, 781/1, 782/2, 1658, 55, 1689/1765, 1639, 1643, 1649, 1640, 1658, P.S.-Baguiati, Dist.-24Pgs(N), under Rajarhat Gopalpur Municipality.

The revised plan submitted by you was scrutinized and marked as found necessary from fire safety point of view. In returning one set of plan, this office is approved **Revised Plan Drawing** in favour of the aforesaid building subject to the compliance of the fire safety measure as recommendation issued earlier vide this office memo no.-WBFES/7943/14/24Pgs(N)-RB/05/14 (05/14) dt.-13/01/14 remain same & strictly to be followed. Along with Fire Fighting Water shall be 5,00,000 Ltrs & Wet Riser shall be 150mm internal diameter pipe line.

Encl. :

1. One set of plan.



Director in Charge
Fire Prevention Wing
WEST BENGAL FIRE & EMERGENCY SERVICES

RECOMMENDATION

A. CONSTRUCTION :

1. The whole construction of the proposed building shall be carried out as per approved plan drawings conforming the relevant building rules of local Municipal Body.
2. The floor area exceeds 750m² shall be suitably compartmented by separation walls up to ceiling level having at least two hours Fire resisting capacity.
3. The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specifications.
4. Provision of ventilation at the crown of the central core-duct of the building shall be provided.
5. Arrangements shall have to be made for sealing all the vertical & horizontal ducts by the materials of adequate Fire resisting capacity.

B. OPEN SPACE & APPROACH :


1. The open space surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire appliance with turning facility.
2. The approach roads shall be sufficiently strong to withstand the load of Fire Engine weighting up to 45 M.T.
3. The width and height of the access gates into the premises shall not be less than 4.5 – 5 M respecting abutting the road.

C. STAIRCASE :

1. The staircase of the building shall be enclosed type. Entire construction shall be made of bricks / R.C.C. type having Fire resisting capacity not less than 4 hours.
2. The staircase of the building shall have permanent vents at the top and openable sashes at each floor level in the external wall of the building.
3. The width of the staircases shall be made as marked in the plan. Corridors and the exit doors shall conforming the relevant building rules with up-to-date amendments.
4. All the staircase shall be extended up to terrace of the building and shall be negotiable to each floor.
5. Fire and smoke doors at the entrances of all the Staircase enclosures as marked in the plan at each floor level shall be provided. The F.C.D. shall be of at least one hour Fire resisting wire glass window fitted with self-closing type openable in the direction of escape.

D. LIFT :

1. The walls of the lift enclosure shall be at least two hours Fire resisting type. Collapsible gate shall not be permitted.
2. One of the lift shall be designed for Fire Lift. The word "FIRE LIFT". Shall conspicuously written at ground floor.
3. Alternate Source of power supply shall be provided for all lifts through Manually operated change over switch.
4. In case of failure normal electric supply it shall automatically trip over to alter supply.
5. The speed of the fire lift shall be such that it can reach the top floor from ground level within one minute.

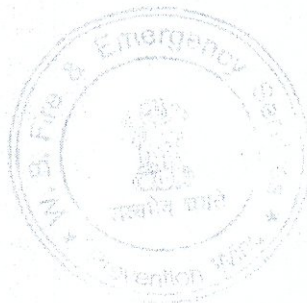

6. Lift and Lift Lobby communicate to the basement shall have to be pressurized as in C-1.5 (g) and (h) of N.B.C.-IV, Annex -C,

E. HALL:

1. The doors/aisles/gangway/cross gangways/seating arrangement/corridors in Hall etc. shall be made as per good practices of national building code, Part-IV Fire protection as well as the conforming norms of cinematograph Act with upto date Amendment.
2. N.O.C. in connection to the Cinema, Video, Restaurant etc shall be obtained from appropriate authority.
3. The safety arrangement for the projection rooms shall be complied with as specified in the Cinematograph Act with upto date amendment.

F. BASEMENT:


1. The Basement shall be adequately ventilated with aggregate cross sectional area of not less than 2.5% of the area spread evenly round the perimeter of the basement shall be provided in the form of grills.
2. Mechanical smoke venting arrangements shall be provided to the entire basement conforming the I.S. Specification. The system shall be of such design as to operate on actuation of heat/smoke sensitive detector or sprinkling. It shall also have an arrangement to start it manually.
3. The exit from the basement shall be form open Air and form any points the travel distance shall not exceeds 18.5 M to reach any exit.
4. All the basement shall be protected with Automatic Sprinkler/Hose Reel Hose System conforming to I.S. 3844-1989.
5. The staircase of basement shall be of enclosed type having Fire resistance of not less than 4 hrs. and shall be situated at the periphery of the basement to be entered at ground level only from the open air and in such positions that smoke from any Fire in the basement shall not obstruct any exit having the ground upper floor of the building.
6. Mechanical extractors shall have an alternative source of supply.
7. Mechanical extractor shall have an internal locking arrangement so that extracting shall continue to operate and supply fans shall stop automatically with the actuation of Fire Detectors.
8. Mechanical extractors shall be designed to permit 30 Air changes per hour in case of Fire or distress call.
9. Basement shall never be used other than car parking area and Fire pump room.
10. All side cut out openings in the basement shall be protected by sprinkler head at close spacing so as to form a water curtain in the event of a fire.

G. FIRE FIGHTING WATER :

Underground water reservoir having water capacity of 3,00,000 ltrs. and overhead reservoir of 15,000 ltrs. capacity exclusively for Fire fighting purpose with replenishing arrangements @ 1000 ltrs./min. Preferably from two different sources of water supply shall be provided. The water reservoir shall have overflow arrangement with the domestic water reservoir as well as to avoid stagnancy of water. The water reservoir shall be kept full at all time.

H. HYDRANT SYSTEM :

1. The building shall be provided with Wet Riser at 100mm. internal diameter Pipe Line at the rate of one such riser for 1000 Sq.m. of floor area. The system shall be so designed that shall be kept charged with Water all the time under pressure and capable to discharge 2280 ltrs/min. at the ground floor level outlet and minimum 900lts/min. at the top most outlet. In both cases the running pressure shall not be less than 3.5Kgs/Sq.cm. All other requirements shall conforming I.S. 3844 - 1989.

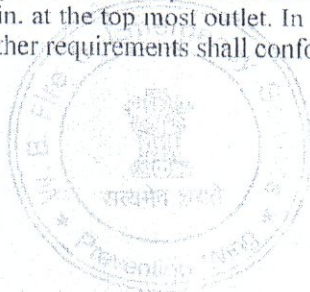

- 2 Provision for Hose Reel in conjunction with Wet Riser shall be made at each floor level. Conforming the relevant I. S. Specifications.
- 3 Yard Hydrant/Ring Main Hydrant with provision of 12(Twelve) numbers Hydrant shall be installed along with 3Nos. Fire Service inlet surrounding the building in accordance with relevant I.S. specifications.

I. SPRINKLER INSTALLATION:

1. The automatic Sprinkler installation shall be provided in Basement areas, Show room, Community hall of the building as per I.S. 9972. Alarm gang to be incorporated along with the sprinkler system.

J. FIRE PUMP :

Provision of the Fire Pump shall have to be made to supply water at the rate-designed pressure and discharge into the Water based system, which shall be installed in the building. One such pump shall always be kept on stand-by preferably be of diesel driven type.

A Separate Fire pump shall preferably be made for the total Sprinkler Installation of the Building. Provision of Jockey Pump shall also have to be made to keep the Water based system under pressurized condition at all the time. All the pumps shall be incorporated with both manual and auto starting facilities. The suction of pumps shall preferably of positive type or in case of negative suction the system shall be wet riser-cum-down comer with suitable terrace pump with overhead tank. A separate Fire pump shall be provided for the total sprinkler installation of the project area.


K. ELECTRICAL INSTALLATION & DISTRIBUTION :

- 1 The electrical installation including transformers, Switch Gears, Main & Meters etc. and the distribution system of the premises shall be made satisfying the code of practice for Fire safety in general building as laid down in I.S. specification 1946 – 1982.
- 2 The vertical ducts shall be supply sealed at alternative floor level.
- 3 The electrical installation shall be adequately protected with CO₂/D.C.P.
- 4 Alternative Power Supply :

Arrangements shall have to be made to supply power with the help of a generator to operate at least the Fire Pump, Pump for deep Tube-well, Fire Alarm System, etc. and also for illuminating the Staircase, corridors etc. and other places of assembly of the building incase of normal power failure.

L. INTELLIGENCE ANALOGUE SYSTEM :

1. Auto Fire Alarm System with analogue addressable smoke / Heat detector as per suitability shall be installed in all floor area of show rooms, club, community hall, Gymnasium area
2. Addressable analogue manual call boxes incorporating with sounders shall be installed in all floors area of community hall, club, Gymnasium, showrooms of the building in such a manner that maximum travel distance shall not be more than 22.5 mtrs. in order to reach any of the call point.
3. Micro Processor based fire alarm panel shall be installed and all shall also be connected with main panel at the Fire Control Room of the premises having direct dialing facility to the local fire service unit.
4. Both way public address systems shall be made available in all floors including basement of the building. The system shall be connected to the Main Control Room.
5. All the installations shall also be satisfy the I.S. specifications 2189 (as amended) and the code of practice as laid down in the N.B.C. Part-IV.

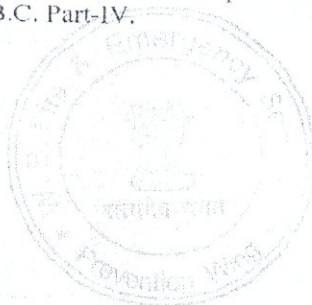

M. AIR CONDITIONING SYSTEM (If any) :

1. The A.H.U. shall be separated for each floor with the system Air Ducts for individual floors.
2. Arrangement shall be made for isolation at the strategic locations by incorporating auto dampers in the Air Conditioning system.
3. The system of auto shut down of A.H.U. shall be incorporated with the auto detection and alarm system.
4. The air handling units room shall not be used for storage of any combustible materials.

N. FIRST AID FIRE FIGHTING SYSTEM :


First Aid Fire fighting arrangement in the style of placing suitable type of portable Fire Extinguishers, Fire Buckets etc. in all floors and vulnerable locations of the premises shall be made in accordance with I.S. 2190 – 1992.

O. GENERAL RECOMMENDATIONS :

- 1 Fire License shall have to be obtained for proposed storing and processing with L.P.G. and other highly combustible articles.
- 2 Fire Notice for Fire Fighting and evacuation from the building shall be prepared and be displayed at all vulnerable places of the building.
- 3 Floor numbers and directional sign of escape route shall be displayed prominently.
- 4 The employees and security staff shall be conversant with installed Fire Fighting equipments of the building and to operate in the event of Fire and Testing.
- 5 Arrangement shall be made for regular checking, testing and proper maintenance of all the Fire Safety installation and equipments installed in the building to keep them in perfectly good working conditions at all times.
- 6 A crew of trained Fireman under the experienced Officer shall be maintained round the clock for safety of the building.
- 7 Mock Fire practice and evacuation drill shall be performed periodically with participation of all occupants of building.
- 8 Each year a certificate is to be obtained from the **Director General, West Bengal Fire & Emergency Services** certifying about the satisfactory services, performance of all the Life and Fire Safety arrangements and installation of the building.

On compliance of all the above Fire and Life safety recommendations, the **Director General, West Bengal Fire & Emergency Services** shall be approached for necessary inspection and testing of the installation, Final N.O.C. in favour of the occupancy shall be issued on being satisfied with the tests and performances of safety aspects of installation of the building.

N.B. : Any deviation and changes the nature of use of the building in respect of the approved plan drawing, without obtaining prior permission from this office, this Fire Safety Recommendation will be treated as cancelled.


12/11/14
DIRECTOR IN CHARGE
FIRE PREVENTION WING
WEST BENGAL FIRE & EMERGENCY SERVICES

