


FIRE-FIGHTING ARRANGEMENT

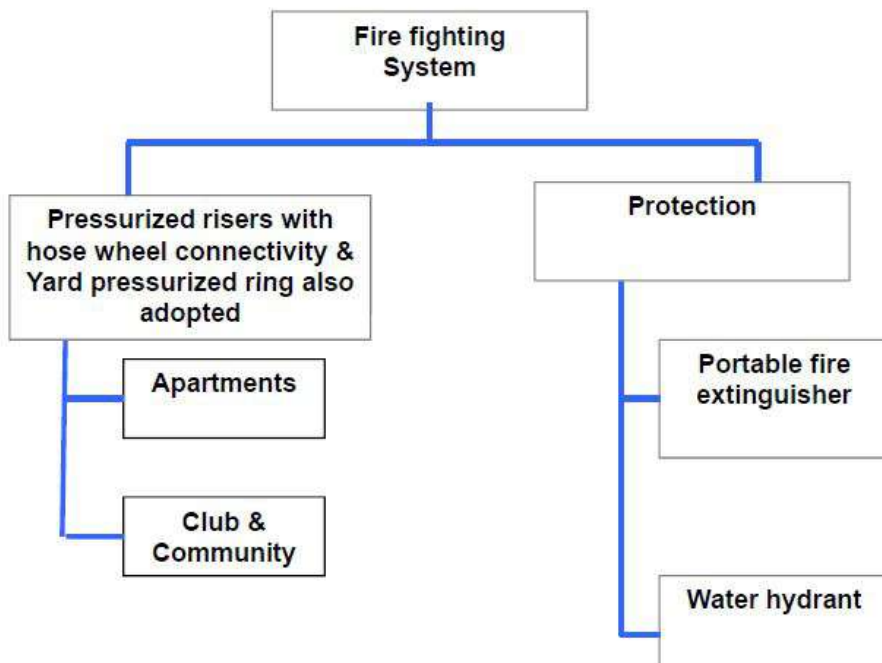

- Fire fighting arrangement has been considered as per the fire norms.
- Dedicated storage facility has been considered for fire fighting arrangement .
- Sprinkler suppression system has been considered as per the norms for the MLCP.
- Fire escape, fire refuge area has been incorporated in the building design as per the rule.
- Emergency assembly at ground level has also been earmarked.
- During operational phase trained facility management team will conduct mock drill.
- Training to the facility management staff on fire fitting system will be conducted.