

② ✓

GOVERNMENT OF WEST BENGAL
OFFICE OF THE DIRECTOR GENERAL
WEST BENGAL FIRE & EMERGENCY SERVICES
13-D, Mirza Ghalib Street, Kolkata – 700 016

Memo No. : WBFES/ 5329 117 /Burdwan - RB/666/17 (666/17) Date: 21-07-12

From : The Divisional Fire Officer,
Fire Prevention Wing
West Bengal Fire & Emergency Services.

To : P. R. Goenka,
Constituted Power of Attorney
Mouza – Bhiringi, P. S. – Durgapur,
Dist. – Bardhaman.




Sub : Fire Safety Recommendation for proposed G+XIV storied Residential Building at premises No- R. S. Dag No. – 568, 567, 561, 3151 & 3150, L. R. Dag No. – 915, 916, 923, 922 & 937, L. R. Khatian No. – 10590, 10593, 10589 & 10588, J.L. No. – 119, Mouza – Bhiringi, P. S. – Durgapur, Dist. Bardhaman.

This is in reference to your letter No. – Nil dated 03.05.2017 regarding Fire Safety measure for proposed G+XIV storied Residential Building at premises No- R. S. Dag No. – 568, 567, 561, 3151 & 3150, L. R. Dag No. – 915, 916, 923, 922 & 937, L. R. Khatian No. – 10590, 10593, 10589 & 10588, J.L. No. – 119, Mouza – Bhiringi, P. S. – Durgapur, Dist. Bardhaman.

The plan submitted by you was scrutinized and marked as found necessary from fire safety point of view. In returning one set of plan with recommendation, this office is issuing Fire Safety Recommendation in favour of the aforesaid building subject to the compliance of the following fire safety measures.

Encl. :

1. One set of plan.
2. Recommendation


DIVISIONAL FIRE OFFICER
FIRE PREVENTION WING
WEST BENGAL FIRE & EMERGENCY SERVICES

RECOMMENDATION

X

A. CONSTRUCTION:

1. The whole construction of the proposed building shall be carried out as per approved plan drawings conforming the relevant building rules of local Municipal Body.
2. The floor area exceeds 750m² shall be suitably compartmented by separation walls up to ceiling level having at least two hours Fire resisting capacity.
3. The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specifications.
4. Provision of ventilation at the crown of the central core-duct of the building shall be provided.
5. Arrangements shall have to be made for sealing all the vertical ducts by the materials of adequate Fire resisting capacity.

B. OPEN SPACE & APPROACH:


1. The open space surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire appliance with turning facility.
2. The approach roads shall be sufficiently strong to withstand the load of Fire Engine weighting up to 45 M.T.
3. The width and height of the access gates into the premises shall not be less than 4.5M – 5 M respecting abutting the road.

C. STAIRCASE:

1. The staircase of the building shall be enclosed type. Entire construction shall be made of bricks / R.C.C. type having Fire resisting capacity not less than 4 hours.
2. The staircase of the building shall have permanent vents at the top and openable sashes at each floor level in the external wall of the building.
3. The width of the staircases shall be made as marked in the plan. Corridors and the exit doors shall conforming the relevant building rules with up-to-date amendments.
4. All the staircase shall be extended up to terrace of the building and shall be negotiable to each other without entering into any room.
5. Fire and smoke doors at the entrances of one number Staircase enclosures at each floor level shall be provided. The F.C.D. shall be of at least one hour Fire resisting wire glass window fitted with self-closing type openable in the direction of escape.

D. LIFT:

1. The walls of the lift enclosure shall be at least two hours Fire resisting type. Collapsible gate shall not be permitted.

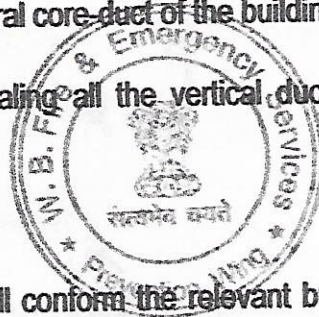

One of the lift shall be designed for Fire Lift. The word "FIRE LIFT". Shall conspicuously written at ground floor.

E. FIRE FIGHTING WATER:

Underground water reservoir having water capacity at 1, 00,000 ltrs. and overhead reservoir of 20,000 ltrs. capacity for each Tower exclusively for Firefighting purpose with replenishing arrangements @ 1000 ltrs./min. Preferably from two different sources of water supply shall be provided. The water reservoir shall have overflow arrangement with the domestic water reservoir as well as to avoid stagnancy of water. The water reservoir shall be kept full at all time.

F. HYDRANT SYSTEM:

- 1 The Each Tower of the building shall be provided minimum Wet Riser at 150mm. internal diameter Pipe Line with provision of landing valves at the Staircase landings / half landings at the rate of one such riser for 1000 Sq.m. of floor area. The system shall be so designed that shall be kept charged with Water all the time under pressure and capable to discharge 2280 ltrs/min. at the ground floor level outlet and minimum 900lts/min. at the top most outlet. In both cases the running pressure shall not be less than 3.5Kgs/Sq.cm. All other requirements shall conforming I.S. 3844 – 1989.
- 2 Provision for Hose Reel in conjunction with Wet Riser shall be made at each floor level. Conforming the relevant I. S. Specifications.
- 3 Yard Hydrant / Ring Main Hydrant shall be installed adequate numbers along with Fire Service inlet surrounding the building in accordance with relevant I.S. specifications.

G. FIRE PUMP:

Provision of the Fire Pump shall have to be made to supply water at the rate-designed pressure and discharge into the Water based system, which shall be installed in the building. One such pump shall always be kept on stand-by preferably be of diesel driven type.

Provision of Jockey Pump shall also have to be made to keep the Water based system under pressurized condition at all the time. All the pumps shall be incorporated with both manual and auto starting facilities. The suction of pumps shall preferably of positive type or in case of negative suction the system shall be wet riser-cum-down comer with suitable terrace pump with overhead tank.

H. ELECTRICAL INSTALLATION & DISTRIBUTION:

- 1 The electrical installation including transformers, Switch Gears, Main & Meters etc. and the distribution system of the premises shall be made satisfying the code of practice for Fire safety in general building as laid down in I.S. specification 1946 – 1982.
- 2 The vertical ducts shall be supply sealed at alternative floor level.
- 3 The electrical installation shall be adequately protected with CO₂/D.C.P. Fire Extinguishers.

4 Alternative Power Supply :

Arrangements shall have to be made to supply power with the help of a generator to operate at least the Fire Pump, Pump for deep Tube-well, Fire Alarm System, etc. and also for illuminating the Staircase, corridors etc. and other places of assembly of the building incase of normal power failure.

I. DETECTION AND ALARM SYSTEM:

1. Manually operated Electrical Fire Alarm system with at least three numbers of break glass type call boxes fitted with Hooters along with public address system, at each floor connecting with panel board shall be made in Control Room. The Control Room shall be located at the entrance of Ground Floor of the building, other requirements of the system shall be made conforming I.S. 2189 – 1988.
2. Hooter will be sounded in such a manner so that an operation of a Detector or Manual Call Point Hooters will sounded on the same floor and immediate alternate floor.
3. Smoke Detector provided at the passageway at each building.

4. Public Address System :-

Public address system linked between all floors and Control Room shall have to be established.



J. AIR CONDITIONING SYSTEM (IF ANY):

1. The A.H.U. shall be separated for each floor with the system Air Ducts for individual floors.
2. Arrangement shall be made for isolation at the strategic locations by incorporating auto dampers in the Air Conditioning system.
3. The system of auto shut down of A.H.U. shall be incorporated with the auto detection and alarm system.
4. The air handling unit's room shall not be used for storage of any combustible materials.


K. FIRST AID FIRE FIGHTING SYSTEM:

First Aid firefighting arrangement in the style of placing suitable type of portable Fire Extinguishers, Fire Buckets etc. in all floors and vulnerable locations of the premises shall be made in accordance with I.S. 2190 – 1992.

L. GENERAL RECOMMENDATIONS:

- 1 Fire License shall have to be obtained for proposed storing and processing with L.P.G. and other highly combustible articles.
- 2 Fire Notice for Fire Fighting and evacuation from the building shall be prepared and be displayed at all vulnerable places of the building.

- 4 The employees and security staff shall be conversant with installed Fire Fighting equipments of the building and to operate in the event of Fire and Testing.
- 5 Arrangement shall be made for regular checking, testing and proper maintenance of all the Fire Safety installation and equipments installed in the building to keep them in perfectly good working conditions at all times.
- 6 A crew of trained Fireman under the experienced Officer shall be maintained round the clock for safety of the building.
- 7 Mock Fire practice and evacuation drill shall be performed periodically with participation of all occupants of building.
- 8 Each year a certificate is to be obtained from the Director General, West Bengal Fire & Emergency Services certifying about the satisfactory services, performance of all the Life and Fire Safety arrangements and installation of the building.

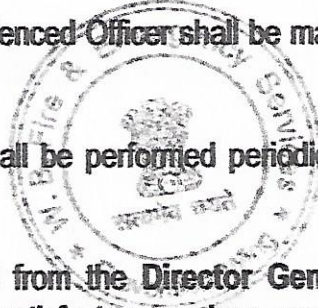

On compliance of all the above Fire and Life safety recommendations, the Director General, West Bengal Fire & Emergency Services shall be approached for necessary inspection and testing of the installation, Fire Safety Certificate in favour of the occupancy shall be issued on being satisfied with the tests and performances of safety aspects of installation of the building.

N.B.: Any deviation and changes the nature of use of the building in respect of the approved plan drawing, without obtaining prior permission from this office, this Fire Safety Certificate will be treated as cancelled.

[Handwritten signature]
20/11/17

**DIVISIONAL FIRE OFFICER
FIRE PREVENTION WING
WEST BENGAL FIRE & EMERGENCY SERVICES**

✓

GOVERNMENT OF WEST BENGAL
OFFICE OF THE DIRECTOR GENERAL
WEST BENGAL FIRE & EMERGENCY SERVICES
13-D, Mirza Ghalib Street, Kolkata - 700 016

Memo No. : WBFES/ 4549 / 17 /Burdwan - RB/666/17 (666/17) Date : 27-06-17

From : Divisional Fire Officer,
Fire Prevention Wing
West Bengal Fire & Emergency Services.

To : P. R. Goenka,
Constituted Power of Attorney
Mouza - Bhiringi, P. S. - Durgapur,
Dist. - Bardhaman.

Sub : Demand Notice under Section 11E of WBFES Act 1950 as amended for issue of Fire Safety Recommendation for proposed construction of G+XIV storied under group Residential Building, at premises No- J.L. No. - 119, Mouza - Bhiringi, P. S. - Durgapur, Dist. Bardhaman.


With reference to the building application submitted in respect to the above proposed this is to inform you that the building permit along with the sanctioned plan will be issued subject to the payment of fee amounting **Rs.-52,676/-** you are hereby requested to remit the above amount within immediate from the date of issuance of Demand Notice.

Total Floor Area (in Sq. mtr.).....	17558.53 mtr. ²
Ground Floor Area (in Sq. mtr.)	1245.81 mtr. ²
Total Additional Floor Area	Nil
Primary Ground of Occupancy	Residential Building.
Abutting Road width	36.0 mtr. in South side & 6.0 mtr. in North side.
Amount in words.....	Rupees - Fifty Two Thousands Six Hundred Seventy Six only.

Mode of Payment:

Treasury challan drawn in favour of "0070-other Administrative Services-60-109 Fire Protection and Control-001-fees under the "West Bengal Fire Services Act-14-Service Fees" (A/C's Code: 0070-60-109-001-14) to be deposit in Treasury/RBI.

The Treasury/RBI challan receipt (In Original) should be submitted in this office, on receipt of the Fire Safety recommendation will be issued.


DIVISIONAL FIRE OFFICER
FIRE PREVENTION WING
WEST BENGAL FIRE & EMERGENCY SERVICES

GOVERNMENT OF WEST BENGAL
OFFICE OF THE DIRECTOR GENERAL
WEST BENGAL FIRE & EMERGENCY SERVICES
13-D, Mirza Ghalib Street, Kolkata – 700 016

Memo No. : WBFES/ 4549 / 17 /Burdwan - RB/666/17 (666/17) Date : 27-06-17

From : Divisional Fire Officer,
Fire Prevention Wing
West Bengal Fire & Emergency Services.

To : P. R. Goenka,
Constituted Power of Attorney
Mouza – Bhiringi, P. S. – Durgapur,
Dist. – Bardhaman.

Sub : Demand Notice under Section 11E of WBFES Act 1950 as amended for issue of Fire Safety Recommendation for proposed construction of G+XIV storied under group Residential Building, at premises No- J.L. No. – 119, Mouza – Bhiringi, P. S. – Durgapur, Dist. Bardhaman.


With reference to the building application submitted in respect to the above proposed this is to inform you that the building permit along with the sanctioned plan will be issued subject to the payment of fee amounting **Rs.-52,676/-** you are hereby requested to remit the above amount within immediate from the date of issuance of Demand Notice.

Total Floor Area (in Sq. mtr.).....	17558.53 mtr. ²
Ground Floor Area (in Sq. mtr.)	1245.81 mtr. ²
Total Additional Floor Area	Nil
Primary Ground of Occupancy	Residential Building.
Abutting Road width	36.0 mtr. in South side & 6.0 mtr. in North side.
Amount in words.....	Rupees – Fifty Two Thousands Six Hundred Seventy Six only.

Mode of Payment:

Treasury challan drawn in favour of "0070-other Administrative Services-60-109 Fire Protection and Control-001-fees under the "West Bengal Fire Services Act-14-Service Fees" (A/C's Code: 0070-60-109-001-14) to be deposit in Treasury/RBI.

The Treasury/RBI challan receipt (In Original) should be submitted in this office, on receipt of the Fire Safety recommendation will be issued.


DIVISIONAL FIRE OFFICER
FIRE PREVENTION WING
WEST BENGAL FIRE & EMERGENCY SERVICES

To

The Director General
W. B. F. & B. S.
13-D, Mirza Ghalib Street,
Kolkata - 700016

Sub: Application for Fire N.O.C. of a G+14 Store
Proposed Residential Flat Building at
R. S. Dag NO - 568, 567, 561, 3151, 431
L. R. " " - 915, 916, 923, 922, 4937.
L. R. Khata NO - 10590, 10593, 10589, 10
Mouza - BHIRINGI, S. L. NO. - 119., P. S. DURGA
DIST. BURDHAMAN

Sir,

We are enclosing all the necessary documents in connection
of the above mentioned subject for your earliest approval &
obligation.

Thanking you,


D. A)

- i) 9 sets of Ammonia Print Plan.
- ii) ~~enclosed documents.~~

Yours faithfully

Prabir Roy Gohain

Dated, 26.04.17

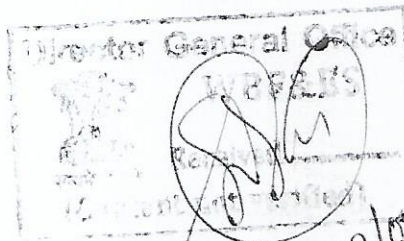

02/05/17