

PROJECT:-
 PROPOSED G+XI STORIED RESIDENTIAL BUILDING AT PRE. NO. 86/1, P. MAJUMDAR ROAD, KOLKATA 700078. R.S. DAG NO.4078.4079. R.S. KHATIAN NO.2233.1082, UNDER MOUZA- KASBA. JLNO.13, TOUZI NO. 145 WARD NO.106, BORROUGH - XII.

- NOTES:
- THIS DRG. SHALL BE READ IN CONJUNCTION WITH RELEVANT ARCH DRG.
 - ALL DIMENSIONS ARE IN mm & LEVELS AER IN M.M. UNLESS NOTED OTHERWISE.
 - GRADE OF CONCRETE SHALL BE M-30 UPTO 7TH. FLOOR ABOVE 7TH. FLOOR M-25
 - UNLESS OTHERWISE SPECIFIED ALL REINFORCEMENT STEEL SHALL BE OF GRADE Fe-500 CONFORMING TO I.S. 1786-1985
 - CLEAR COVER TO REINFORCEMENT:-
 a) PILE = 50 mm b) PILE CAP = 50 mm
 c) TIEBEAM = 40 mm d) COLUMN = 40 mm
 e) FLOOR BEAM = 25 mm f) FLOOR SLAB = 20 mm
 g) STAIR CASE WAIST SLAB = 20 mm
 h) LIFT WALL = 20 mm
 - LAP/BOND LENGTH SHALL BE 50 x D WHERE D IS THE DIA OF BAR.
 - MIX FOR P.C.C. SHALL BE 1:3:6

CERTIFIED WITH FULL RESPONSIBILITY THAT THE BUILDING PLAN HAS BEEN DRAWN UP AS PER PROVISION OF K.M.C BUILDING RULES 2009 AS AMENDED FROM TIME TO TIME & THAT THE SITE CONDITION INCLUDING THE ADJUTING ROAD CONFORMS WITH THE PLAN, WHICH HAS BEEN MEASURED AND VERIFIED BY ME. IT IS A BUILDABLE SITE AND NOT A TANK OR FILLED UP TANK. THE PLOT IS DEMARCATED BY BOUNDARY WALL. THE PLOT IS BEYOND 500 MT. FROM THE CL OF E.M.BYE PASS THE CONSTRUCTION OF U.G. WATER TANK AND S.T.P. WILL BE COMPLETED BEFORE STARTING OF BUILDING FOUNDATION WORK. DURING DEPARTMENTAL INSPECTION THE PLOT WAS IDENTIFIED BY ME.

[Signature]
 DEBATOSH SAHU (CA/89/12368)
 SIGNATURE OF ARCHITECT & SEAL

STRUCTURAL ENGINEERS' CERTIFICATE
 THE STRUCTURAL DESIGN AND DRAWINGS OF BOTH FOUNDATION & SUPERSTRUCTURE OF THE BUILDING HAS BEEN MADE BY ME CONSIDERING ALL POSSIBLE LOADS INCLUDING THE SEISMIC LOAD AS PER THE NATIONAL BUILDING CODE OF INDIA AND CERTIFIED THAT IT IS SAFE AND STABLE IN ALL RESPECTS.

[Signature]
 BIBEK BIKASH MULLICK
 B.S.E. - 1/75
 KOLKATA MUNICIPAL CORPORATION
 SIGNATURE OF STRUCTURAL ENGINEER & SEAL


- I DO HEREBY DECLARE WITH FULL RESPONSIBILITY THAT
- I SHALL ENGAGE ARCHITECT & E.S.E DURING CONSTRUCTION
 - I SHALL FOLLOW THE INSTRUCTIONS OF ARCHITECT & E.S.E DURING CONSTRUCTION OF THE BUILDING (AS PER B.S PLAN)
 - K.M.C AUTHORITY WILL NOT BE RESPONSIBLE FOR STRUCTURAL STABILITY OF THE BUILDING & ADJOINING STRUCTURAL
 - IF ANY SUBMITTED DOCUMENTS ARE FOUND TO BE TAKE THE K.M.C AUTHORITY WILL REVOKE THE SANCTION PLAN.
 - THE CONSTRUCTION OF U.G WATER TANK & S.T.P WILL BE UNDERTAKEN UNDER THE GUIDANCE OF ARCHITECT / E.S.E BEFORE STARTING OF BUILDING FOUNDATION WORK.
 - THE PLOT IS SITUATED BEYOND 500 M. FROM THE CL OF THE E.M.BYE PASS

[Signature]
 SIGNATURE OF OWNER & SEAL

ARCHITECTS :
 ESPACE
 35A, DR. SARAT BANERJEE ROAD,
 KOLKATA 700-029
 PHNO= 2465-4130,4159


STRUCTURAL DRAWING (SUPERSTRUCTURE)
 SCALE - 1:100
 KSG ENGINEERING CONSULTANTS
 51/2 MAHAJATI NAGAR, BIRATI,
 KOLKATA-700051
 DATE:-06-01-15
 SHEET-3 OF 4

THIS DRAWING IS A PROPERTY OF ESPACE, 35 A, DR. SARAT BANERJEE ROAD, KOLKATA-700 029. ANY MODIFICATION, CHANGES, DEVIATIONS IS NOT PERMISSIBLE WITHOUT PRIOR INTIMATION TO ESPACE. IN THE CONTRARY THIS WILL BE TREATED AS ILLEGAL ACT.

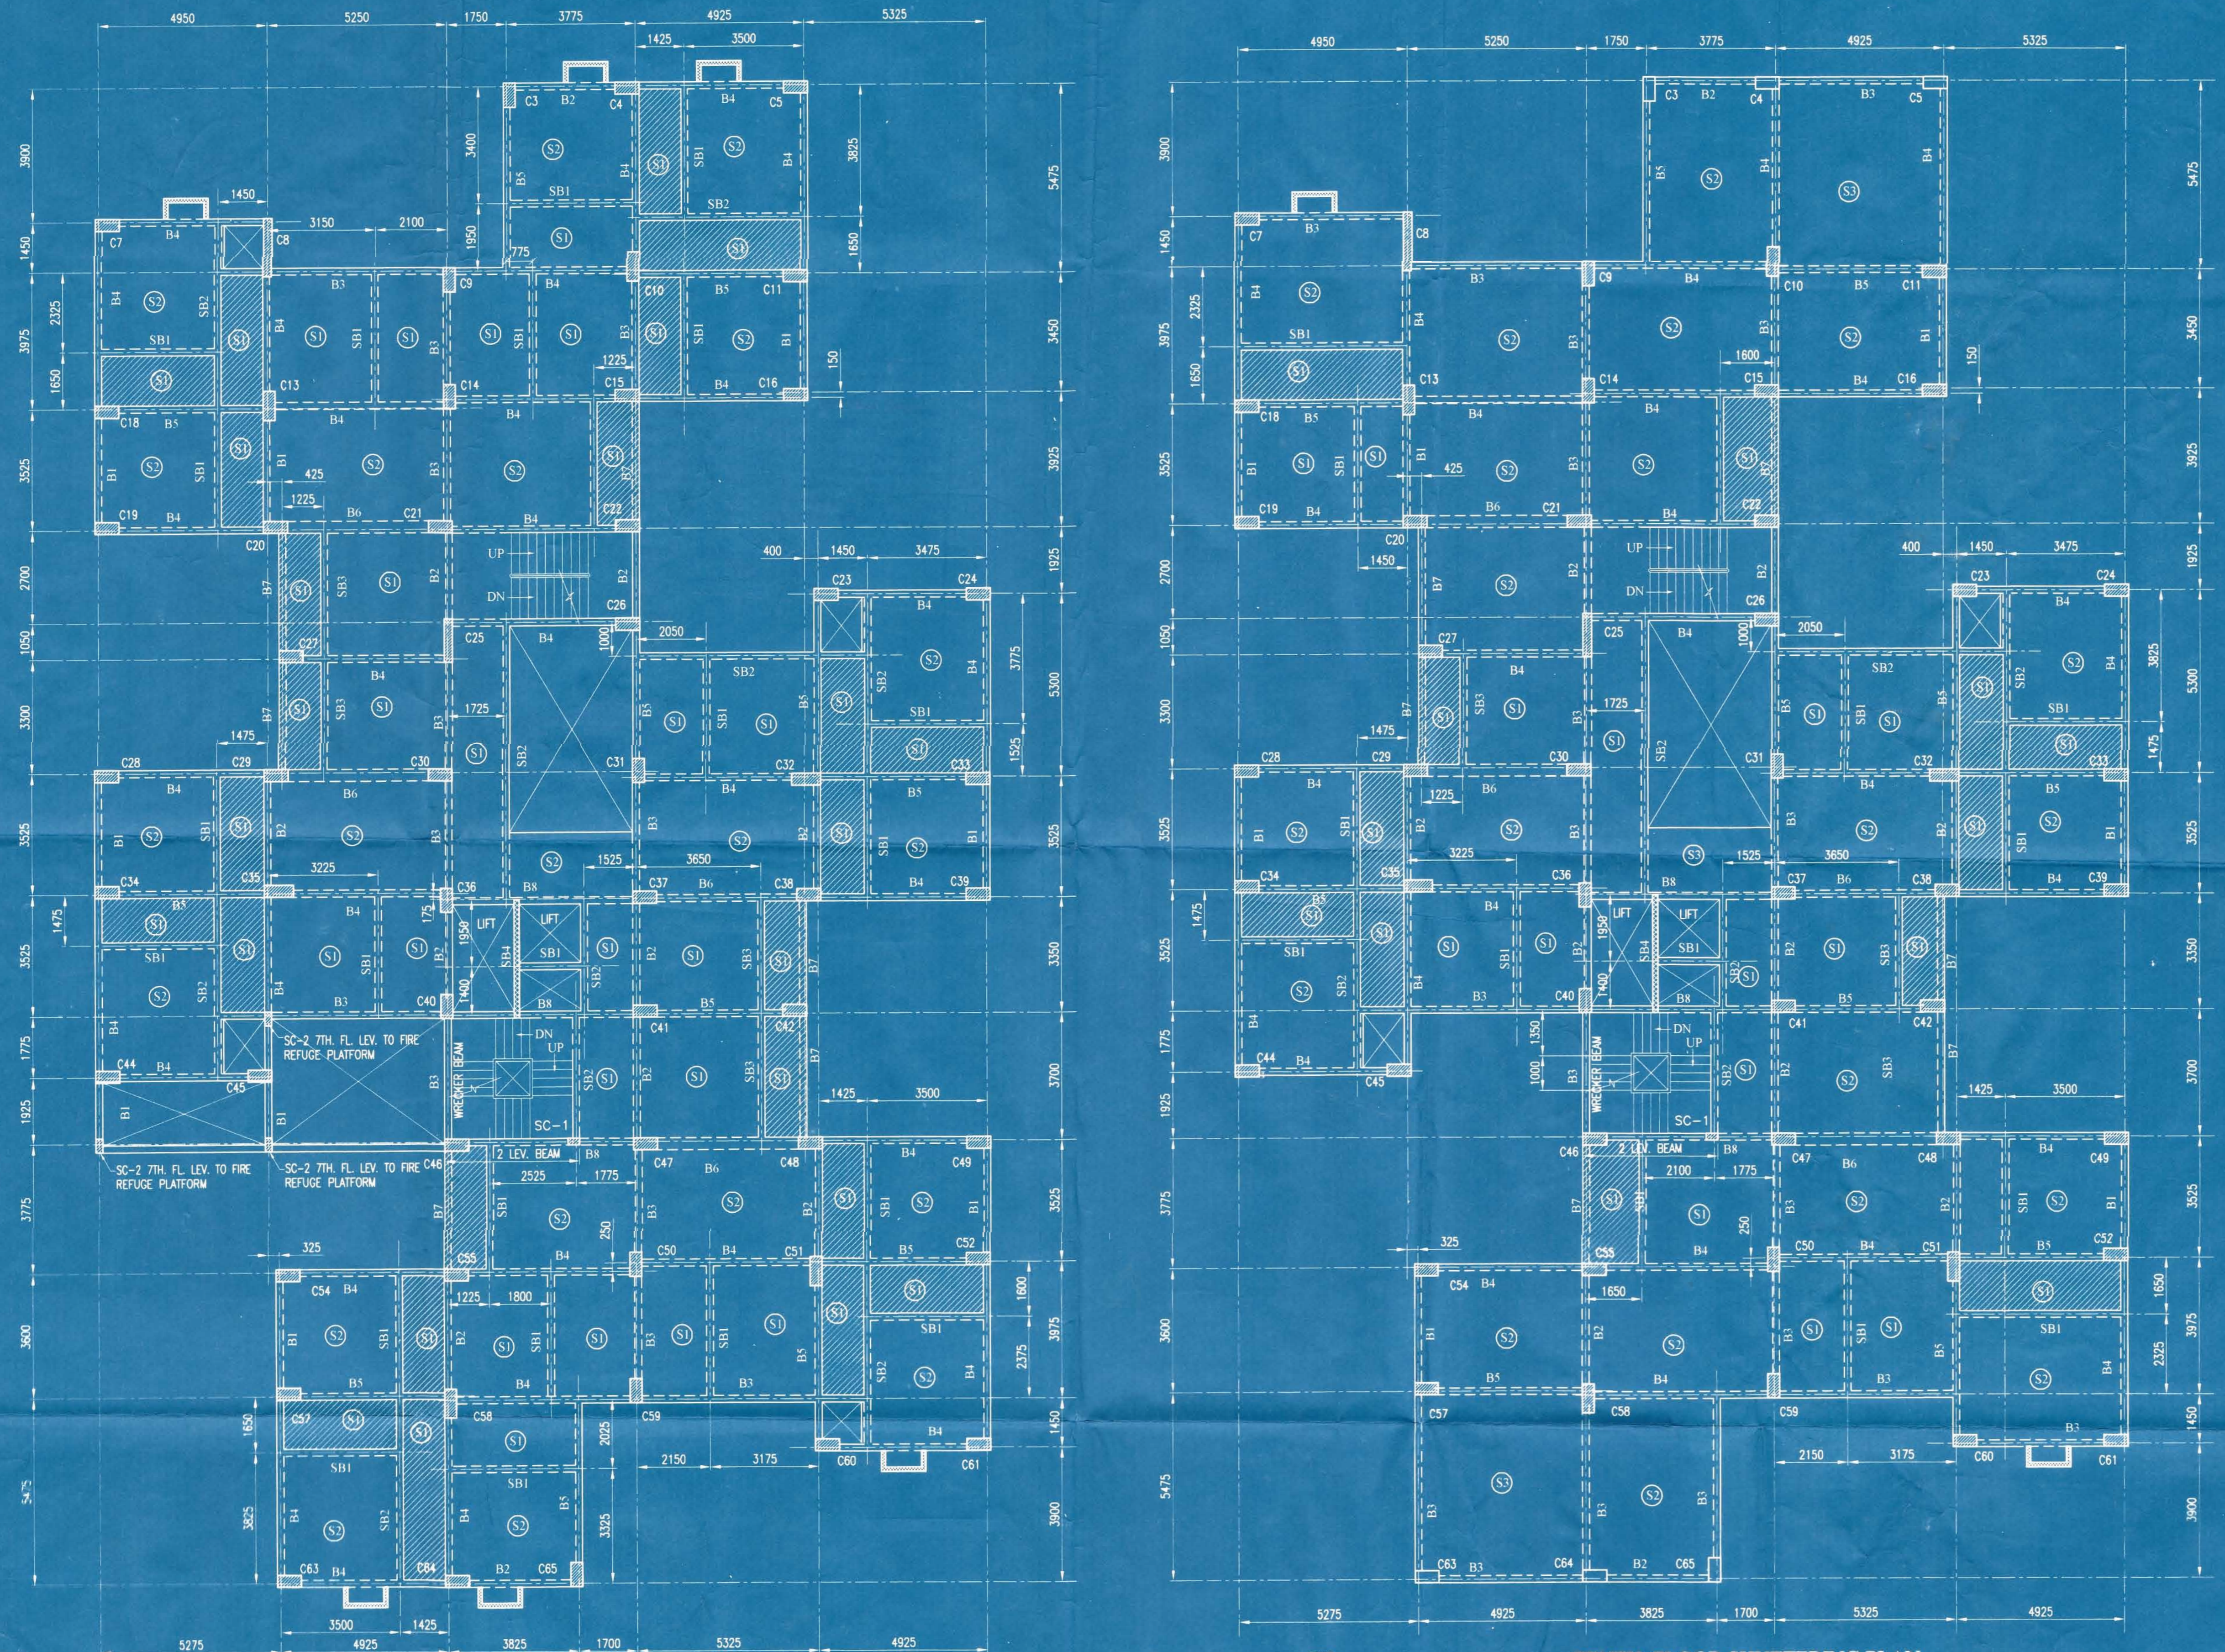

TYPICAL FLOOR SHUTTERING PLAN (3RD TO 9TH.)

TENTH FLOOR SHUTTERING PLAN

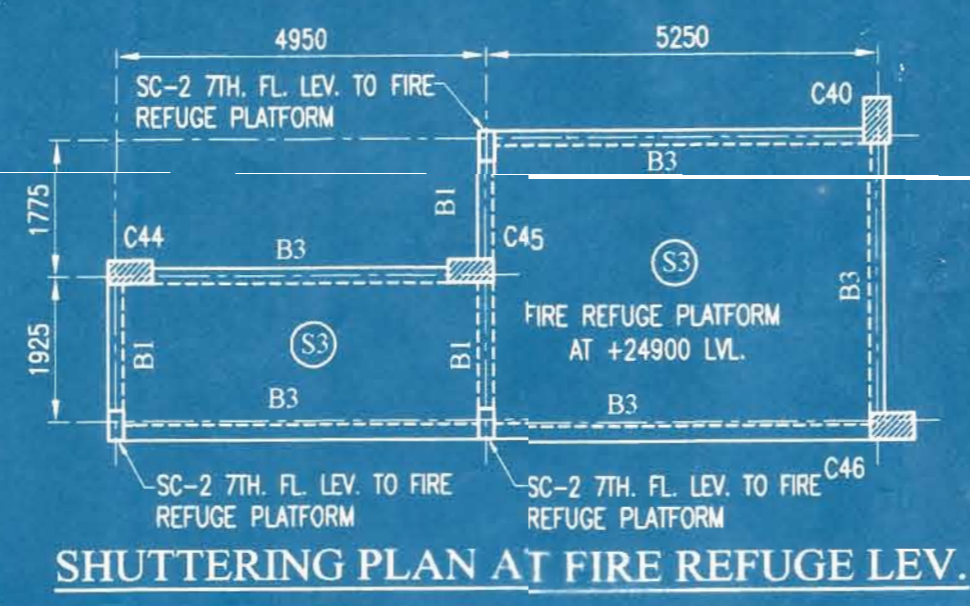

SHUTTERING PLAN AT FIRE REFUGE LEVEL.

S-3

PARTY'S COPY

Structural plan and design calculation as submitted by the structural engineer have been kept with B.P. No. 2014/20391 dated 27/01/15 for record of the Kolkata Municipal Corporation without verification. No deviation from the submitted structural plan should be made at the time of erection without submitting fresh structural plan along with design calculation and stability certificate in the prescribed form, necessary steps should be taken for the safety of the adjoining premises, public and private properties and safety of human life during construction.

[Signature]
EXECUTIVE ENGINEER/ASST. ENGINEER
BOROUGH NO. XII

2014/20391
RECEIVED
27/01/15
Building Department Borough - XII
The Kolkata Municipal Corporation