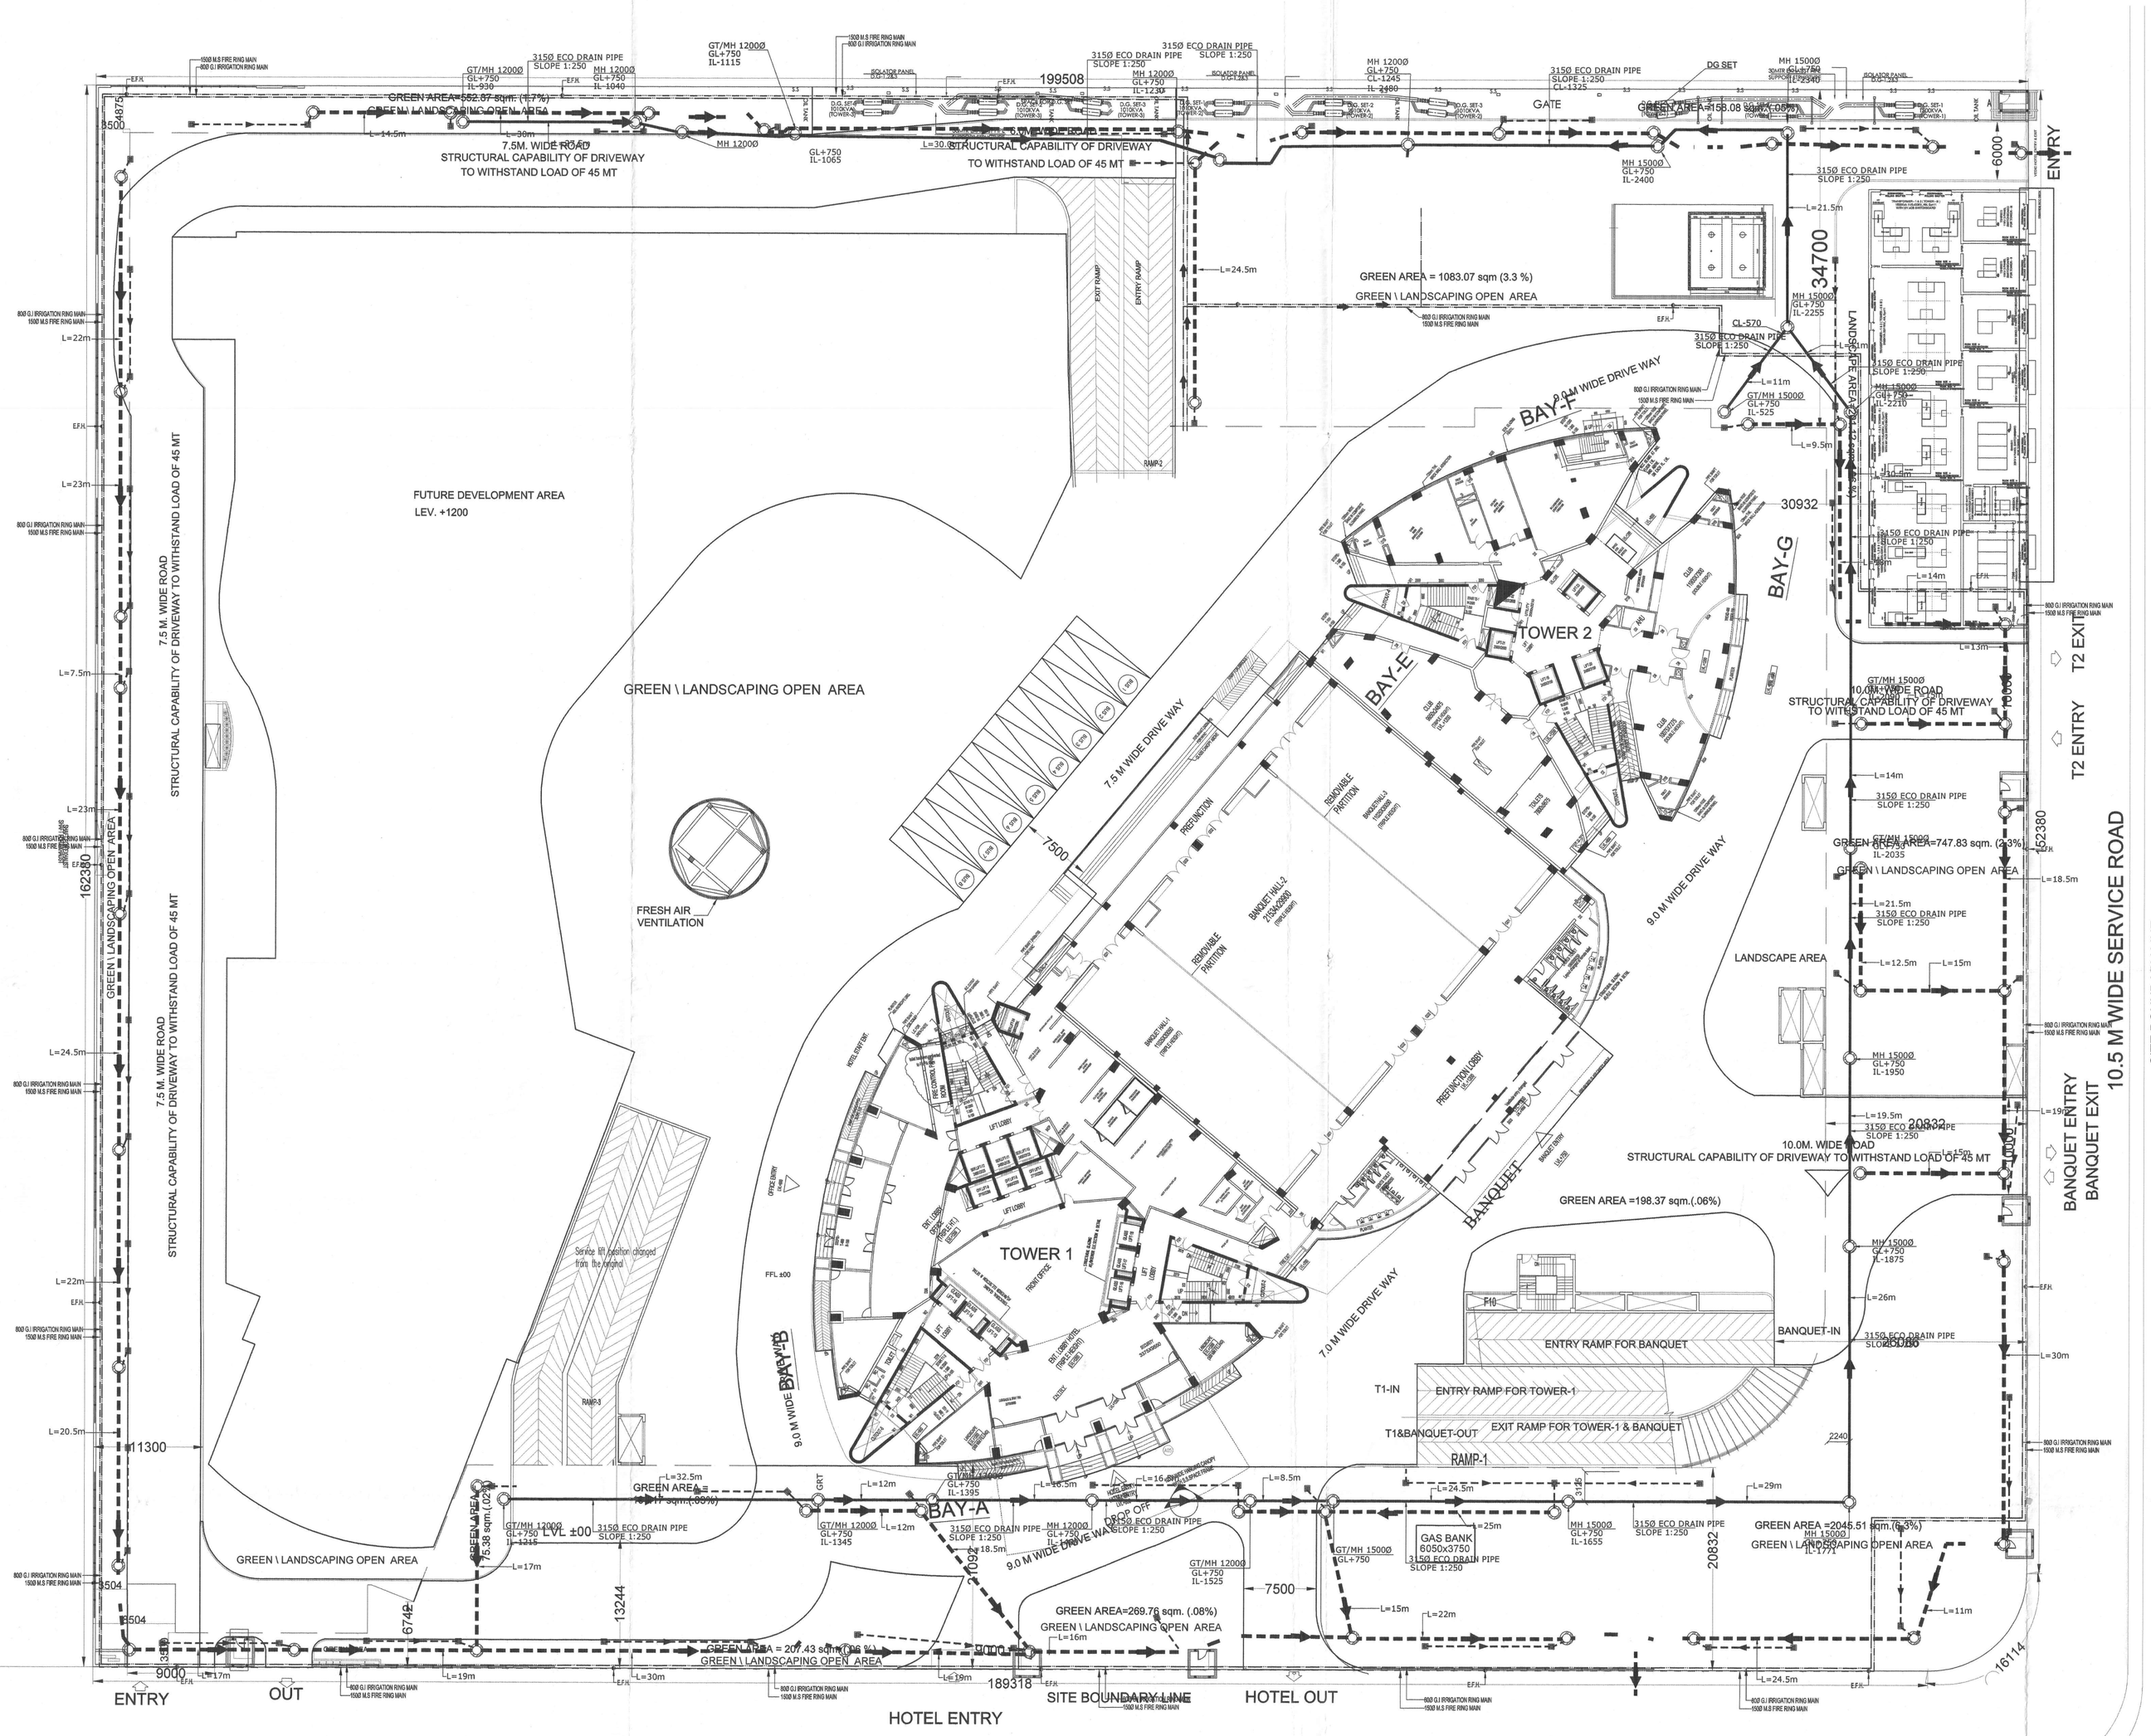

LEGEND: –

G.L	GROUND LEVEL
I.L	INVERT LEVEL
C.L	CONNECTION LEVEL
GH	GARDEN HYDRANT
GT	GULLY TRAP
	CATCH BAISON
	SEWERAGE MANHOLE
	SEWER LINE
	SEWERAGE MANHOLE
	STROM WATER LINE
DIP	DESILTING PIT (3mx1.5m)
GREASE TRAP	GREASE TRAP(1800x900mm)
HP	HARVESTING PIT (3m DIA) CAP.=18m³/HR

SCHEDULE OF MANHOLE

DIA (IN mm)	DEPTH
900Ø	900mm-1650mm
1200Ø	1650mm-2300mm
1500Ø	2300mm-9000mm
1800Ø	9000mm-14000mm

APPLICANT NAME & ADDRESS

SHRISTI INFRASTRUCTURE DEVELOPMENT CORPORATION LTD.
Authorised Signatory/Director

SHRISTI INFRASTRUCTURE DEVELOPMENT CORPORATION LTD.
Plot No. X-1,2&3,Block-EP,Sector-V, Salt Lake City, KOLKATA- 700 091

PRINCIPAL ARCHITECT:

CP Kukreja Associates
Ashirwad Building D-1 Green Park
New Delhi-110016
Phone- 26863953, Fax-11-26865770
E-mail- cpka@cpkukreja.com

CERTIFICATE OF THE ARCHITECT:

I CERTIFY THAT ALL THE ARCHITECTURAL DRAWINGS OF THE PROJECT AT PLOT NO.-AAII/CBD/2, NEW TOWN KOLKATA HAVE BEEN PREPARED BY ME COMPLYING WITH THE PROJECT AREA (BUILDING OPERATIONS) RULES, 2009 AND THE PROJECT AREA (BUILDING OPERATIONS) REGULATIONS, 2009 I SHALL BE HELD RESPONSIBLE IF ANY INCORRECT INFORMATION IS FURNISHED BY ME OR ANY VIOLATION OF PROVISIONS OF THESE RULES AND THE PROJECT AREA (BUILDING OPERATIONS) REGULATIONS, 2009 IS FOUND IN ANY OF THE DRAWINGS AND DOCUMENTS. SIGNED BY ME AND SUBMITTED TO THE SANCTIONING AUTHORITY FOR OBTAINING SANCTION.

Sanjay Mandal
CA/98/23621

SIGNATURE OF THE ARCHITECT
SANJAY MANDAL
ARCH/NKDA/09/00002

ANIRBAN BISWAS
TOWN PLANNER, TPER/NKDA/10/00019

CERTIFICATE OF STRUCTURAL ENGINEER :

Certified that the Structural drawing and design of both the foundations and superstructure of the building has been made considering the Soil Test Report, as per these rules and regulations made under the Act and also considering all possible loads, seismic loads, and the moments generated by the proposed structure as per the Bureau of Indian Standard and National Building Code of India and and certified that it is safe and stable in all respect and these provisions shall be adhered to during the construction.

PRADIP BHAUMIK
[STER/NKDA / 10 / 00013]

CERTIFICATE OF GEO-TECHNICAL ENGINEER :

It is certified that the comprehensive Geo-technical Report on soil investigation has been prepared by me for design and calculation of the foundation by analyzing the soil sample for estimating the bearing capacity of the soil on which foundation of the structure will be constructed .
I shall also check the nature of the soil after excavation at site so that foundation is extended up to appropriate depth that has been proposed in the Geo-technical Report

Geo-Technical Engineer:
PRADIP BHAUMIK
[GTER/NKDA/10/000025]

TITLE: SERVICE DRAWING

~~WATER CONNECTION~~ SEWERAGE LINE, MASTER PIT, INSPECTION PIT

TITLE:

PROPOSED 5 STAR HOTEL COMPLEX
AT RAJARHAT, NEW TOWN KOLKATA
PLOT NO.- AAII/CBD/2, NEW TOWN KOLKATA

DRAWING SHEET NO. : IN/1246/CORP/SR/01

DEALT :
DATE :10.04.2017

SCALE 1 : 200
(UNLESS OTHERWISE MENTIONED)

26/2 Ballygunge Circular Road ,
Udayan Park Flat No.-7, 3rd Floor, Kolkata-700019
FAX : (033) 2289-4026,
www.innateindia.com

NORTH POINT

SL/10-34 (SR)01