


| RevNo | Revision note | Date | Signature | Checked |
|-------|---------------|----------|-----------|---------|
| 0 | | 03.09.19 | | |

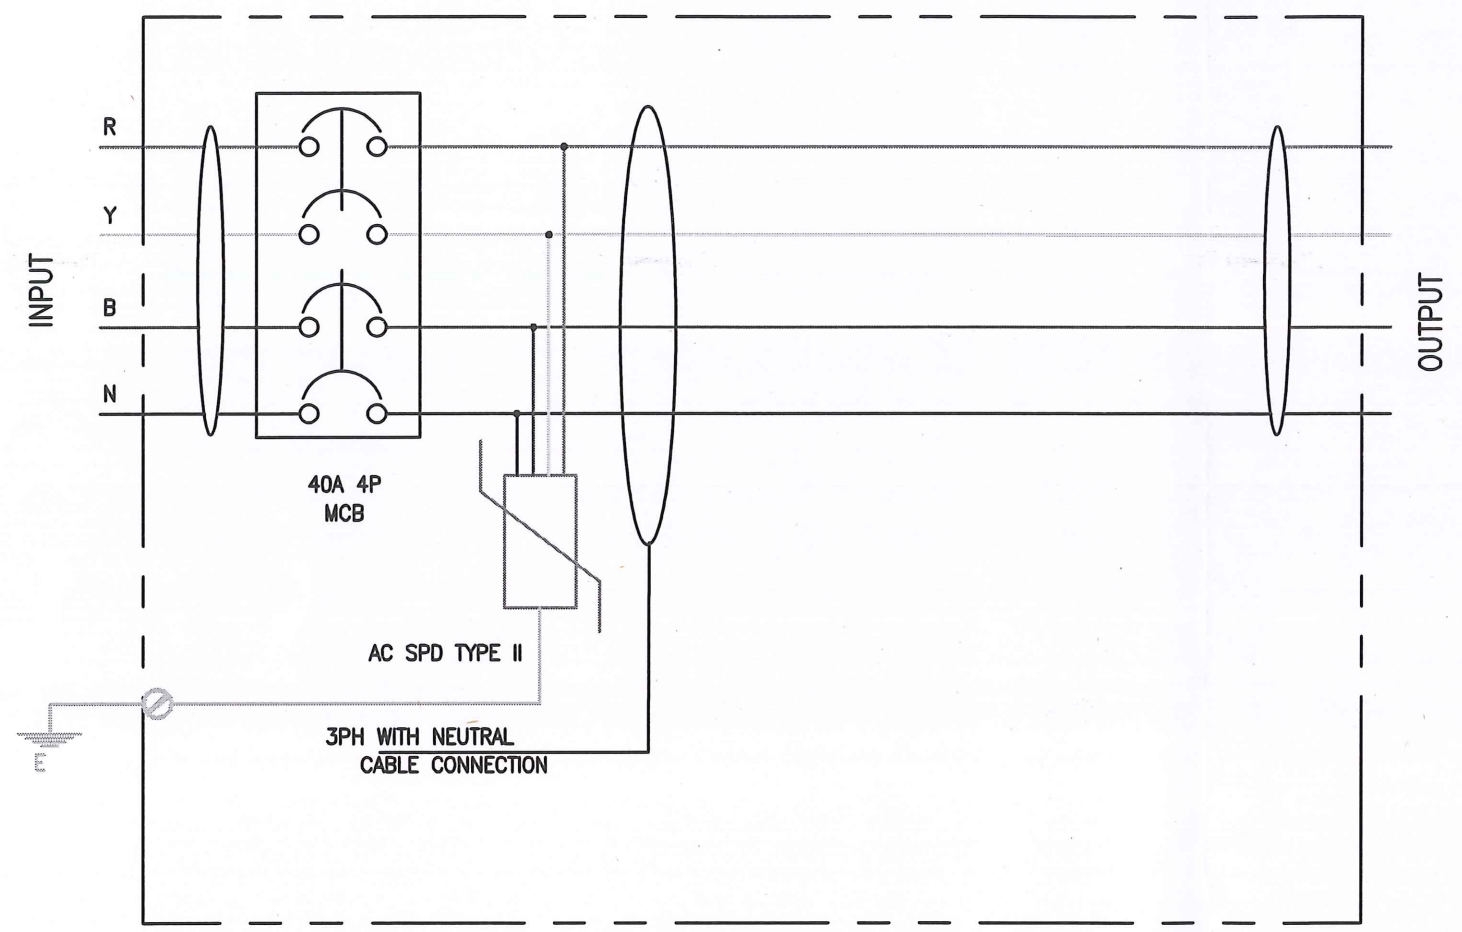

INVERTER INTERFACING PANEL

| BOM | | | |
|-----|---------------------|-----------------------------|-------|
| 1 | 40A 4P 10kA MCB | ABB /SCHNEIDER | 1 No |
| 2 | 415V AC SPD TYPE II | OBO / DEHN / CITEL / MERSEN | 1 No |
| 3 | GLAND | REPUTED | 3 Nos |
| 4 | TERMINAL BLOCK | ELMEX or EQV. | 5 Nos |
| 5 | IP 65 ENCLOSURE | ENSTO / HENSEL | 1 No |

| | | | |
|-------------------|-------------------------|----------------|---|
| NAME OF CUSTOMER: | MERIDIAN SPLENDORA | PROJECT: | 18kWp Plant ADDRESS : 9A/1 UMAKANTA LANE KOLKATA-700030 |
| DRAWING NO. | THEA/18kWp/IIP/19-20/01 | DRAWING TITLE: | Electrical Diagram for Inverter Interfacing Panel |



SRINIVAS INFRA DEVELOPERS (P) LTD.


 Director