

**Government of West Bengal
Office of the Deputy Director, West Zone
West Bengal Fire & Emergency Services
430 G.T. Road, Howrah- 1**

Memo no- WBFES/ DY.DFS-WZ/ FP/ 249 / 13 /HWH/R.B./ 279 /13 **Date** 8/7/13.


From : The Deputy Director ,West Zone,
West Bengal Fire & Emergency Services.

To : Shri Rajkumar Agarwal,
Raj Agarwal & Associates,
8B , Royd Street, 2nd floor ,
Kolkata- 700016.

Sub: Fire & Life Safety Recommendation. for proposed construction of one no G+III & G+ XII storied under group Residential Building as block -1 & 2 respectively at the premises No360 , G.T. Road (S) ,ward no.- 40 under H.M.C., Dist.- Howrah.

This is in reference to your letter No nil dated 02/7/13 regarding Fire & Life Safety Recommendation . for proposed construction of one no G+III & G+ XII storied under group Residential Building as block-1 & 2 at the premises No360 , G.T. Road (S) ,ward no.- 40 under H.M.C., Dist.- Howrah.

The plan drawing submitted by you was scrutinized and marked as found necessary from fire safety point of view. In returning one set of plan with recommendation, this office issuing Fire Safety Recommendation in favour of the aforesaid building subject to compliance of the following fire safety measures.


Deputy Director (West Zone)
West Bengal Fire & Emergency Services

Encló :

1. One set of plan.
2. Recommendation



RECOMMENDATIONS

A. CONSTRUCTION

1. The whole construction of proposed building shall be carried out as per approved plan drawings conforming the relevant building rules of Kolkata Municipal Corporation.
2. The floor area exceeds 750m² shall be suitably compartmented by separation walls up to ceiling level having at least two hours Fire resisting capacity.
3. The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specification.
4. Provision of ventilation at the crown of the central core-duct of the building shall be provided.
5. Arrangements shall have to be made for sealing all the vertical ducts by the materials of adequate Fire resisting capacity.

B.OPEN SPACE& APPROCH:


- 1.The open space surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire appliances with turning facility.
2. The approach roads shall be sufficiently strong to withstand the load of fire engine weighting upto 45 M.T
3. The approach road and internal drive ways and the circulation space always kept free from any obstructions.
4. Internal drive way around the building shall not be less than 6M.
5. The width & Height of the access gates into the premises shall not be less than 4.5M & 5.0M respecting abutting road.

C. STAIRCASE

1. The staircase of the building shall be enclosed type. Entire construction shall be made of bricks/R.C.C. type having fire resisting capacity not less than 4 hrs.
2. The staircase of the building shall have permanent vents at the top and openable sashes at each floor level in the external wall of the building.
3. The width of the staircases shall be made as marked in the plan. Corridors and the exit doors shall conforming the relevant building rules and as well as rules of the cinematograph Act with up to date amendments.
4. All the staircase shall be extended up to terrace of the building and shall be negotiable to each other without entering into any room.
5. Fire and smoked doors at the entrances of all the staircases enclosures as marked in the plan at each floor level shall be provided. The F.C.D. shall be of at least one hour fire resisting wire glass window fitted with self-closing type openable in the direction of escape.
6. The mechanism for pressurizing the staircase shaft shall be so installed that the same shall operate automatically on fire alarm system/sprinkler system and be provided with manual operation facilities

D. LIFT

1. Walls of lift enclosures shall have a fire rating of two hours. Lift shafts shall have a vent a the top of area not less than 0.2 sq m.
2. At least one Lift of the building shall be designed at high speed "FIRE LIFT" and conspicuously indicated at each floor.
3. Lift motor room shall be located preferably on top of the shaft and separated from the shaft by the floor of the room.
4. Landing door in lift enclosures shall have a fire resistance of not less than one hour.
5. The number of lifts in one lift bank shall not exceed four. A wall of two hours fire rating shall separate individual shafts in a bank.
6. Lift car door shall have a fire resistance rating of 1 hour.
7. Collapsible gates shall not be permitted for lifts and solid doors with fire resistance of at least one hour shall be provided.

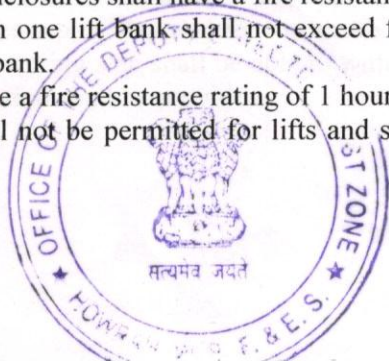


8. If the lift shaft and lobby is in the core of the building a positive pressure between 25 and 30 pa shall be maintained in the lobby and a possible pressure of 50 pa shall be maintained in the lift shaft. The mechanism for the pressurization shall act automatically with the fire alarm/sprinkler system and it shall be possible to operate this mechanically also.
9. Exit from the lift lobby, if located in the core of the building, shall be through a self-closing fire smoke check door of one-hour fire resistance.
10. Lift shall not normally communicate with the basement. If however, lifts are in communication, the lift lobby of the basement shall be pressurized as per N.B.C. part - IV with self closing door .
11. Grounding switch (es), at ground floor level shall be provided to enable the fire service to ground the lifts.
12. Telephone/talk back communication facilities may be provided in lift cars for communication system and lifts shall be connected to the fire control room of the building.
13. Suitable arrangements such as providing slope in the floor of the lift lobby shall be made to prevent water used during fire fighting, etc at any landing from entering the lift shafts.
14. A sign shall be posted and maintained on every floor at or near the lift indicating that in case of fire, occupants shall use the stairs unless instructed otherwise. The sign shall also contain a plan for each floor showing the location of the stairways. Floor marking shall be done at each floor on the wall in front of the lift-landing door.
15. The electric supply shall be on a separate service from electric supply mains in a building and the cables run in a route safe from fire, that is within a lift shaft. Lights and fans in the elevator having wooden paneling or sheet steel construction shall be operated on 24-volt supply. In case of failure of normal electric supply, it shall automatically switch over to the alternate supply.
16. Arrangement shall be provided for extraction of smoke in all the lift shaft by incorporation smoke venting system designed to permit 30 Air changes per hour in case of fire and shall be of such design as to operate on actuation of sprinkler or Fire Alarm in case of failure of normal electric supply . It shall automatically trip to alternate supply or arrangement of pressurization system for fire lift well, lobby area by dedicated shaft.
17. The speed of the fire lift shall be such that it can reach to the top floor from ground level within one minute.
18. All other requirements shall conform the I.S. specification including communication facility in the lift cars connecting with the Fire Control Room of the building/buildings.

E. REFUGE AREA:

1. Refuge area is not less than 15sq.m. shall be provided on the external wall with cantilever projection or other suitable means at 24.65 M. levels of the building as shown in the drawing.
2. The refuge area shall be of Fire resisting construction and protected with closing F.C.D. at the entrance from the corridor or staircase lobbies.
3. The position of refuge Areas shall be such that they are negotiable by the Fire service Ladder from the ground

F. FIRE FIGHTING WATER:

1. Underground water reservoir having water capacity at 50,000 ltrs and overhead reservoir of 20,000Lts Capacity exclusively for Fire fighting purpose with replenishing arrangements @ 1000lts./min. Preferably from two different sources of water supply shall be provided. The fire water Reservoir shall have overflow arrangement with the domestic Water Reservoir as well as to avoid stagnancy of water. The water reservoir shall be kept full at all time.
2. Underground water reservoir should be provided with suitable numbers of manholes to offer facility to Fire engine to insert the Suction Hose to draw water.
3. The static storage water supply required for the above mentioned purpose should entirely be accessible to the fire tenders. The covering slab shall be able to withstand the vehicular load of 45 tones in case of high rise A draw off connection shall be provided.

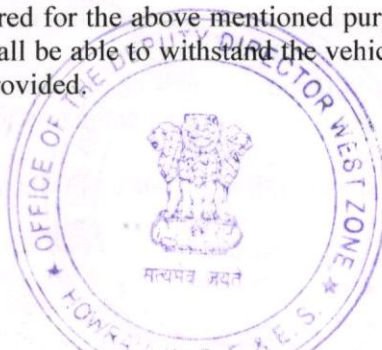

K. AIR CONDITIONING SYSTEM (If any)

1. The A.H.U. shall be separated for each floor with the system Air Ducts for individual floors.
2. Arrangement shall be made for isolation at strategic locations by incorporating auto dampers in the Air Conditioning system.
3. The system of auto shut down of A.H.U. shall be incorporated with the auto detection and alarm system.
4. The air handling units room shall not be used for storage of any combustible materials.

L. FIRST AID FIRE FIGHTING SYSTEM

First Aid Fire fighting arrangement in the style of placing suitable Fire Extinguishers, Fire Buckets etc. in all floors and vulnerable of locations of the premises shall be made in accordance with I.S. 2190-1992.

M. GENERAL RECOMMENDATION:

1. Fire Notice for Fire Fighting and evacuation from the building shall be prepared and be displayed at all vulnerable places of the building.
2. Floor numbers and directional sign of escape route shall be displayed prominently.
3. The employees and security staff shall be conversant with installed Fire Fighting equipments of the building and to operate in the event of Fire and testing.
4. Arrangement shall be made for regular checking, testing and maintenance of all the Fire Safety installation and equipments installed in the building to keep them in perfectly good working conditions at all times.
5. A crew of trained Fireman under the experienced Officer shall be maintained round the clock for safety of the building.
6. Mock Fire practice and evacuation drill shall be performed periodically with participation of all occupants of building.

On compliance of all above Fire and Life safety recommendations, the Dy. Director west zone, West Bengal Fire & Emergency Services shall be approached for necessary inspection and testing of the installation, Fire Safety Certificate . in favour of the occupancy shall be issued on being satisfied with the tests and performances of safety aspects of installation of the building.

N.B. : Any deviation and changes the nature of use of the building in respect of the approved plan drawing. Without obtaining prior permission from this office, this Fire Safety Recommendation. will be treated as cancelled.

**Dy. Director , West zone
West Bengal Fire & Emergency Services**

