


FRONT ELEVATION

FIRE & SAFETY RULES :-

* SEMI GROUND WATER TANK CAPACITY IS 2000 GALLON. TO PREVENT STAGNATION OF WATER IN STATIC WATER STORAGE TANK. THE SANCTION TANK OF DOMESTIC WATER SUPPLY SHALL BE ONLY THROUGH & OVER FLOW TO MAINTAIN THE LEVEL THERE AT THE MINIMUM SPECIFIED CAPACITY.

* HOSE RELL 150 MM. IN EACH FLOOR.

* CO2 TYPE FIRE EXTINGUISHER AS PER I. S. I. SPECIFICATION.

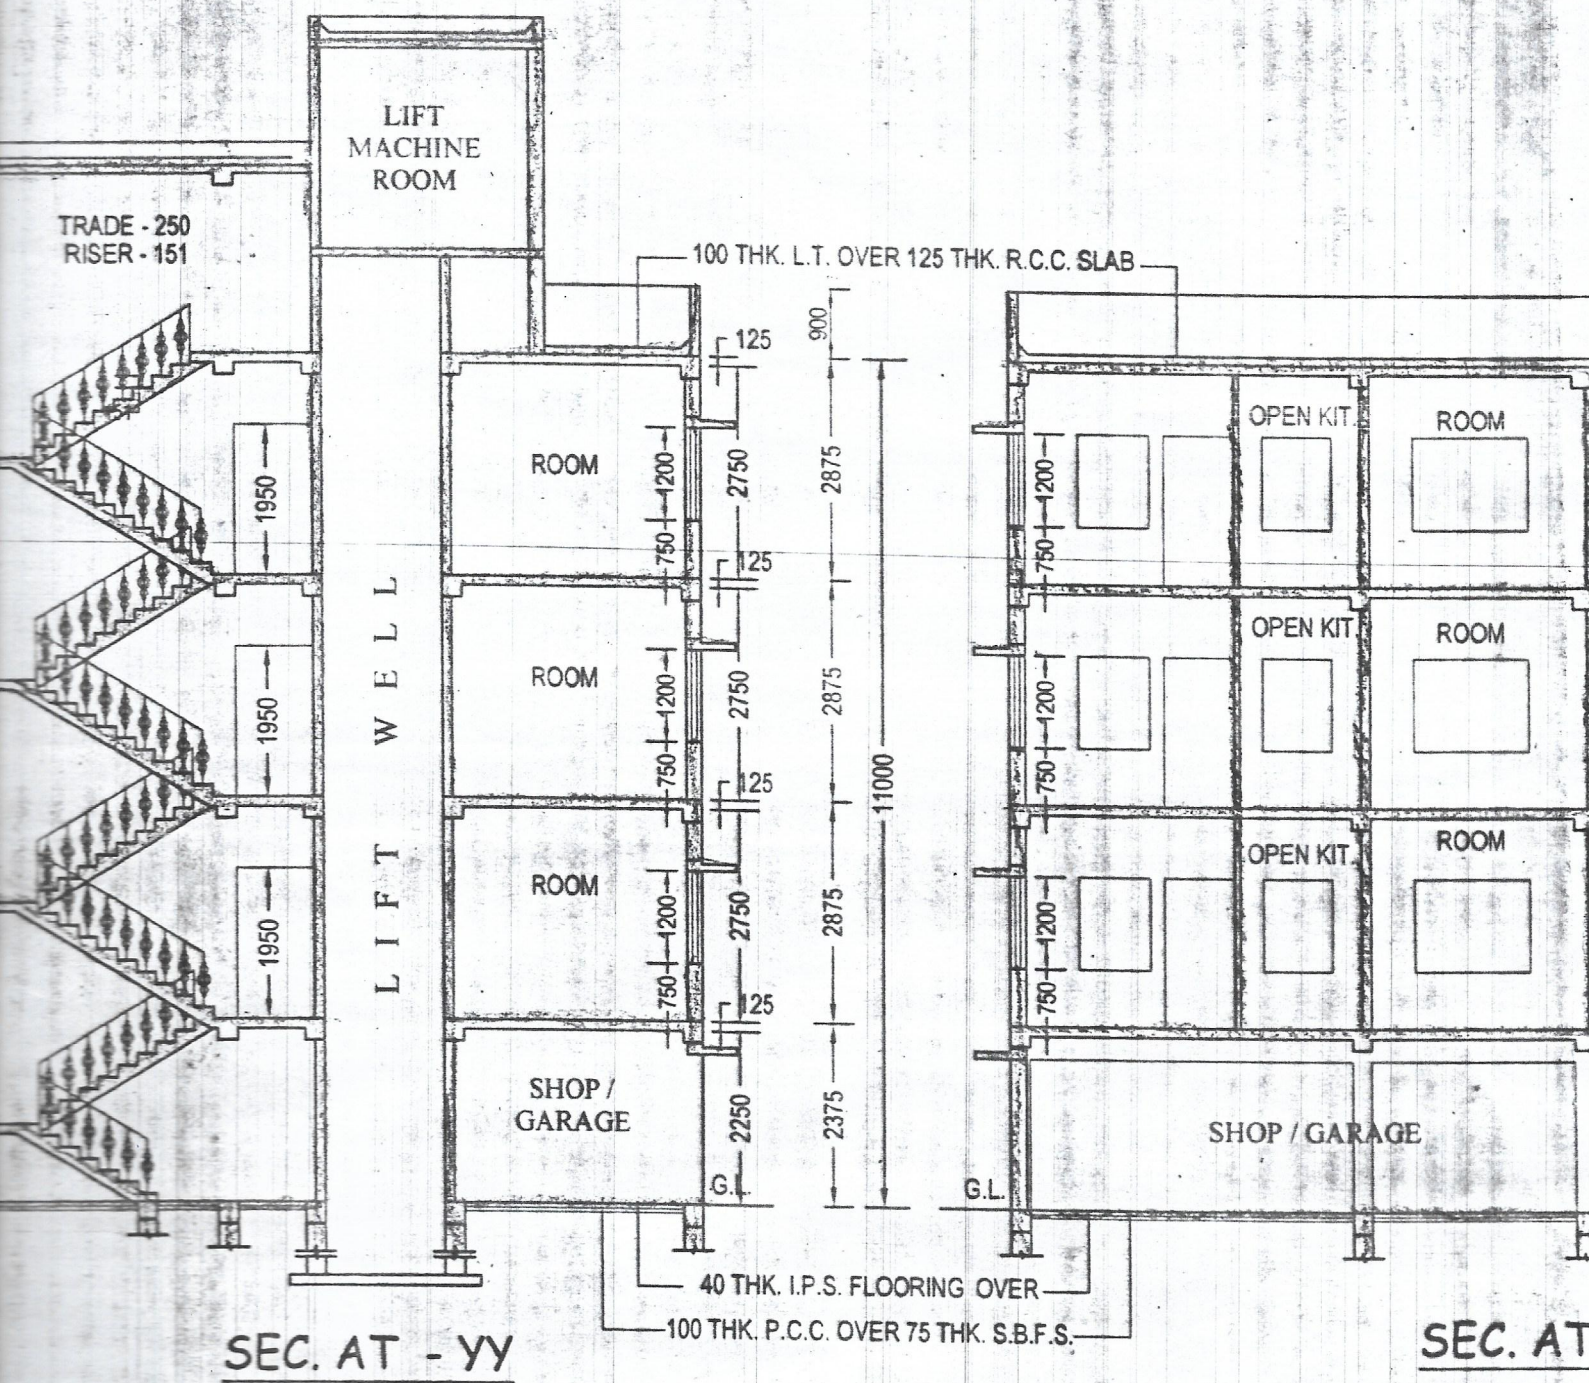

PROPOSED GROUND FLOOR AREA

SHOP / GARAGE -

84.98 SQM.

TWO WHEELER GARAGE

31.64 SQM.