
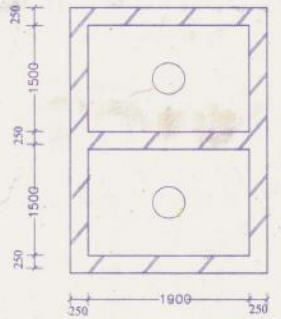


DETL. OF SEPTICTANK & SOAK PIT (FOR 100 USER)


FIRE & SAFETY RULES :-

- * SEMI GROUND WATER TANK CAPACITY IS 10000 LTS. TO PREVENT STAGNATION OF WATER IN STATIC WATER STORAGE TANK, THE SANCTION TANK OF DOMESTIC WATER SUPPLY SHALL BE ONLY THROUGH & OVER FLOW TO MAINTAIN THE LEVEL THERE AT THE MINIMUM SPECIFIED CAPACITY.
- * HOSE REEL 150 MM IN EACH FLOOR.
- * CO2 TYPE FIRE EXTINGUISHER AS PER I. S. I. SPECIFICATION.

○ FIRST AID HOSE REEL
 ▷ CO₂ TYPE FIRE EXTINGUISHER
 □ WATER CO₂ TYPE FIRE EXTINGUISHER

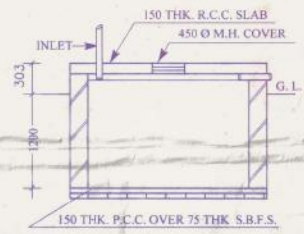


DETL. OF UNDER GROUND WATER RESERVIOR(U.G.R.)

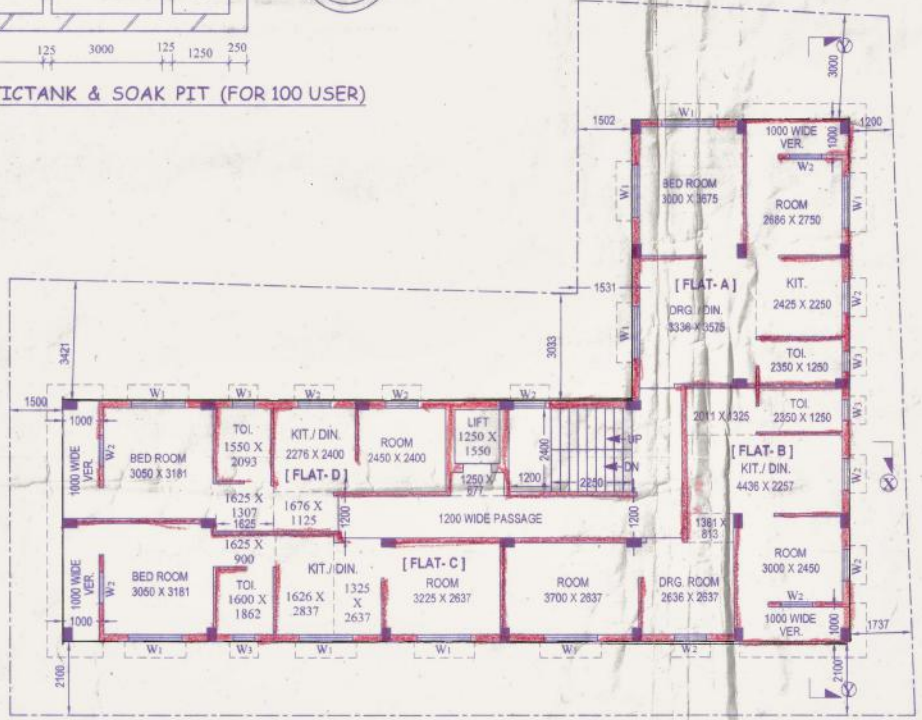

TYPICAL FLOOR PLAN
(FIRST, SECOND & THIRD)

SITE PLAN

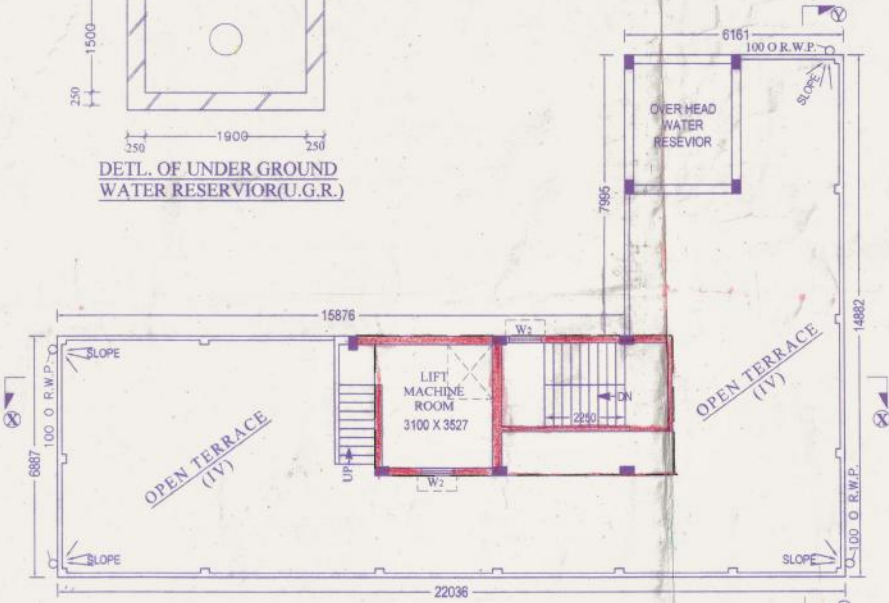

TERRACE PLAN