

**FIRE & SAFETY RULES :-**

\* SEMI GROUND WATER TANK CAPACITY IS 10000 LTS. TO PREVENT STAGNATION OF WATER IN STATIC WATER STORAGE TANK, THE SANCTION TANK OF DOMESTIC WATER SUPPLY SHALL BE ONLY THROUGH & OVER FLOW TO MAINTAIN THE LEVEL THERE AT THE MINIMUM SPECIFIED CAPACITY.

- \* HOSE RELL 150 MM. IN EACH FLOOR.
- \* CO2 TYPE FIRE EXTINGUISHER AS PER I. S. I. SPECIFICATION.


- ⊙ FIRST AID HOSE REEL
- ▷ CO<sub>2</sub> TYPE FIRE EXTINGUISHER
- WATER CO<sub>2</sub> TYPE FIRE EXTINGUISHER

**PROPOSED GROUND FLOOR AREA**


GARAGE / SHOP	- 56.91 SQM.
STAIR, LIFT, COMM.	- 30.31 SQM.
GRUD ROOM	- 09.41 SQM.
COMM. TOILET	- 03.30 SQM.
COMM. GARAGE	- 43.33 SQM.
<b>= 145.26 SQM. [54.27%]</b>	

**PROPOSED TYPICAL FLOOR**


(A + B + C + COMM.)	( 46.03 + 39.65 + 42.51 + 15.07 ) SQM.
<b>= 145.26 SQM. [54.27%]</b>	

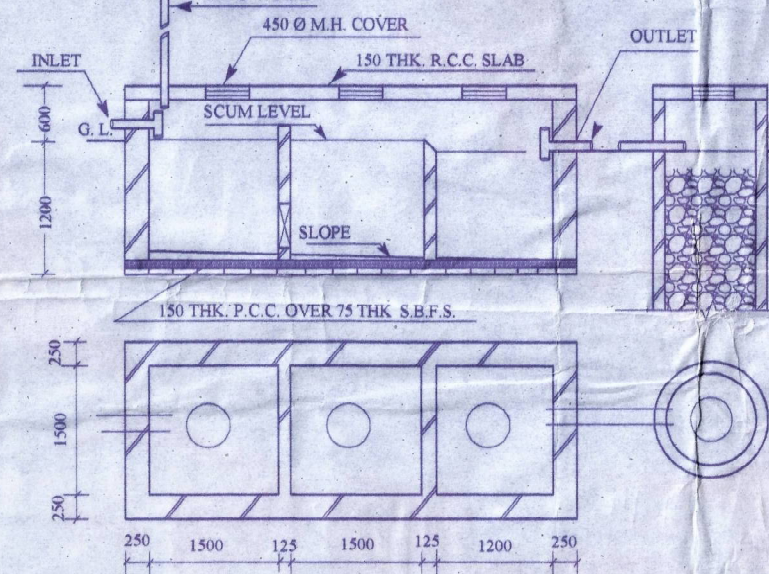


**DETL. OF SEPTICTANK & SOAK PIT (FOR 50 USER)**

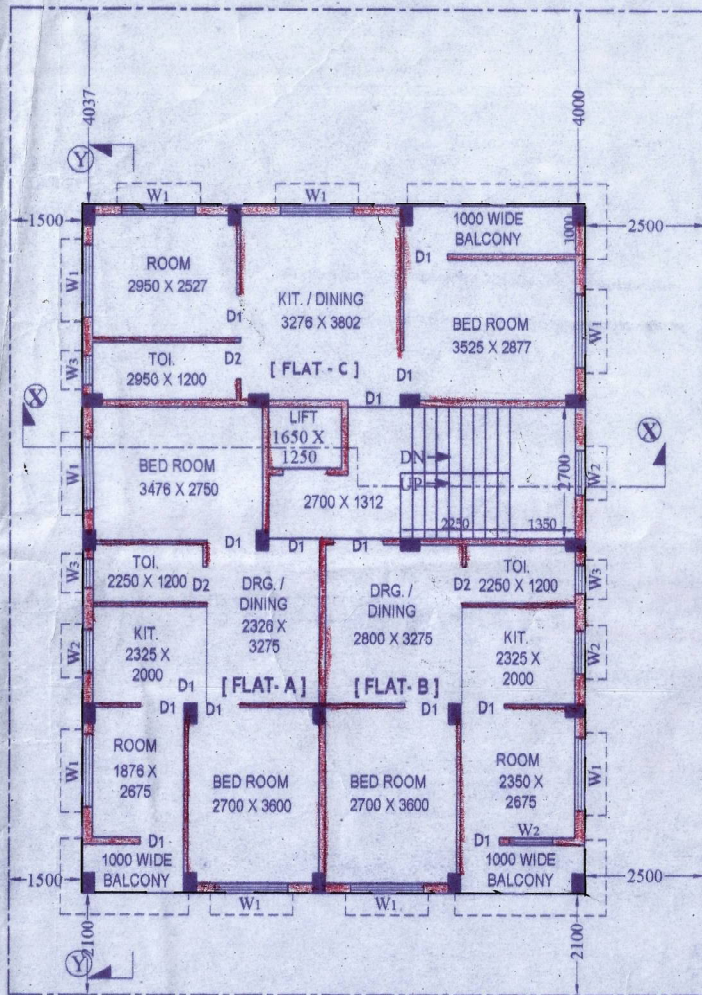

**TYPICAL FLOOR PLAN  
(FIRST, SECOND, THIRD & FOURTH)**

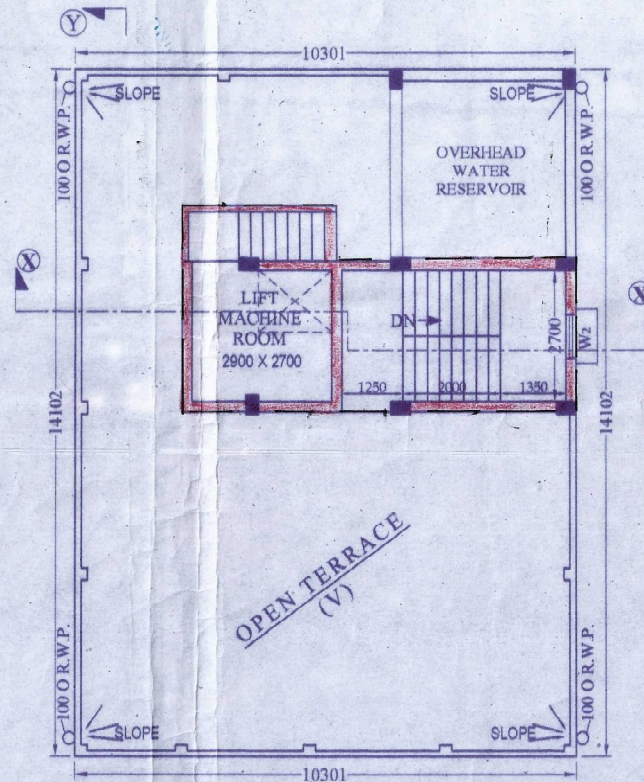

**TERRACE PLAN**

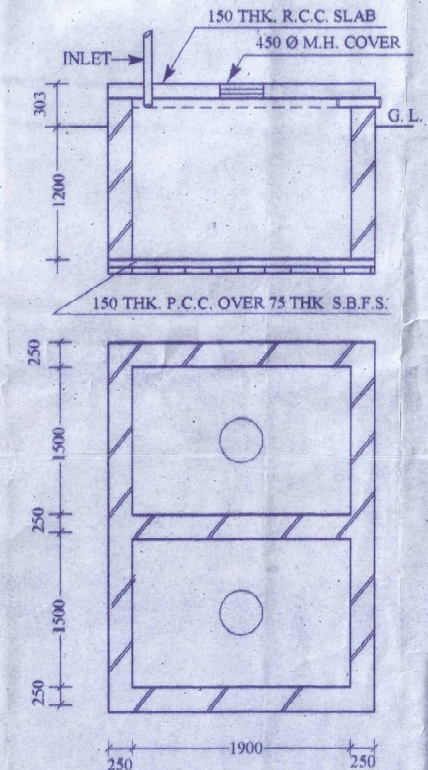

**DETL. OF UNDER GROUND  
WATER RESERVIOR(U.G.R.)**